

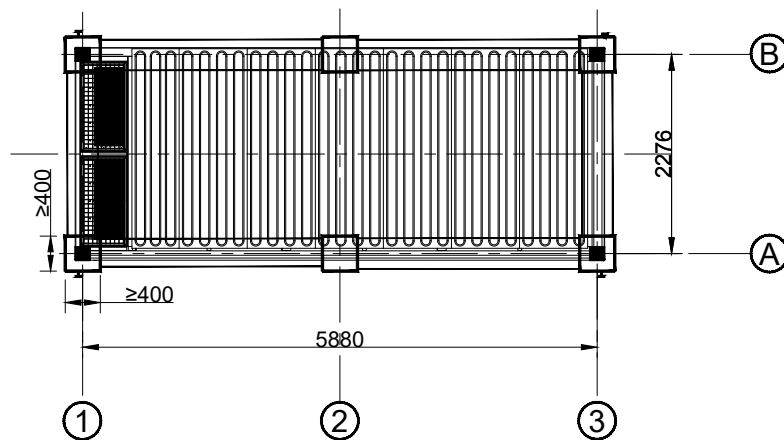


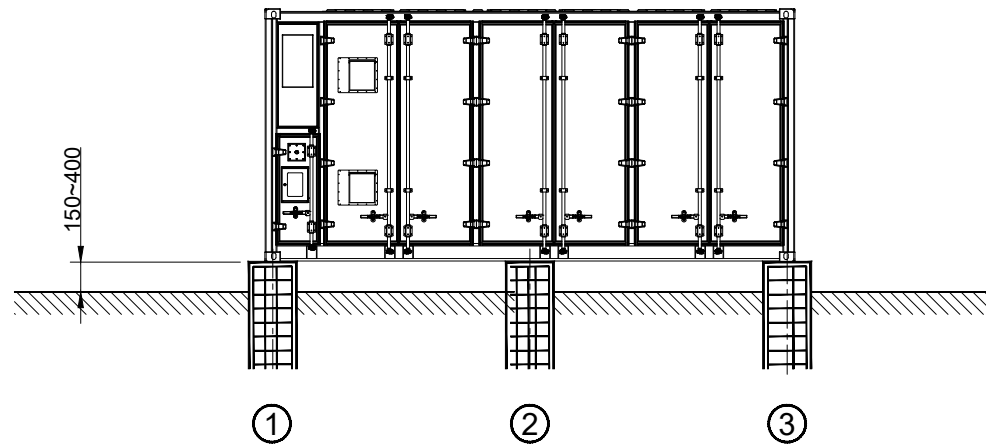


General Notes:

1. All dimensions are in millimeters unless otherwise stated.
2. The bottom of the enclosure needs to be kept 150mm spacing from the ground to allow pack removal/install in the field. And the maximum clearance from the bottom to the ground is 400mm for F-STOP operating height.
3. The bottom surfaces of the four corner pieces of the enclosure must be in complete contact with the support surface, without any racking, to avoid tipping due to uneven forces.

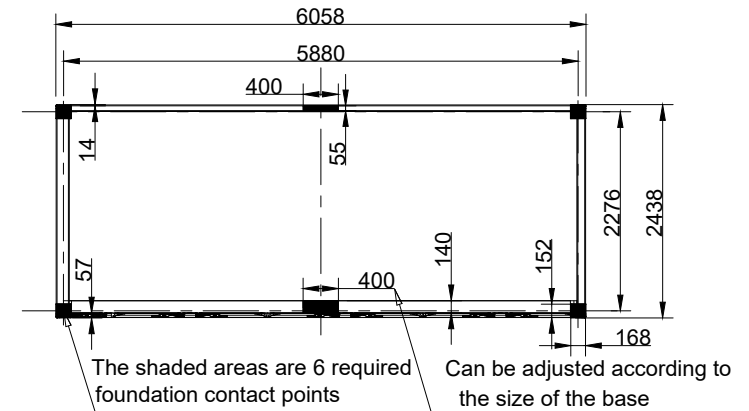

The four corner support points of the container should be centered on the support surface.

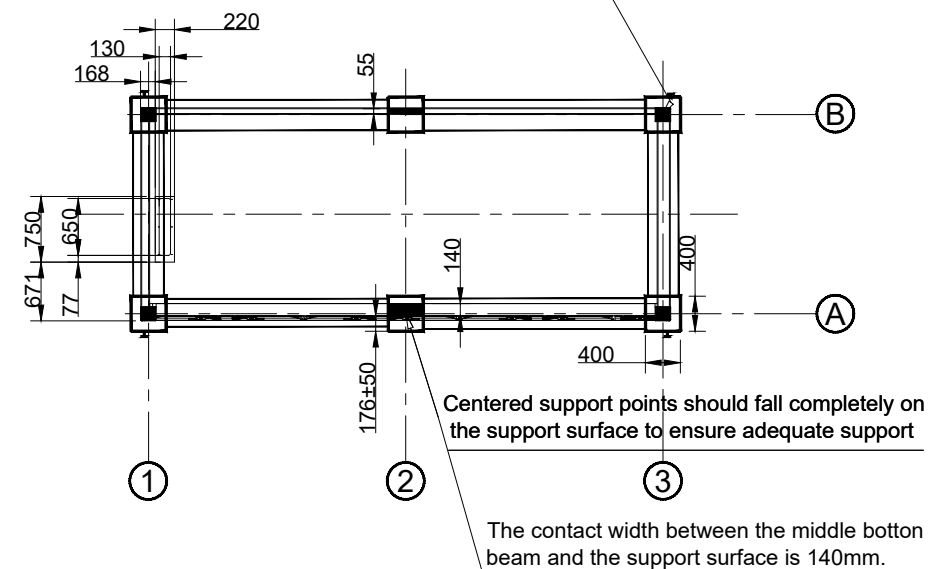

					CanadianSolar				DRAWING NAME: SolBank foundation design example	
NO.	Original Drawing NO.	Change Description	signature	DATE	All rights reserved. No part of this document may be reproduced or transmitted in any form without the written permission of CSI.				DRAWING NO.: M130	
DESIGNED BY	DATE	Standardizing	DATE		REV.	PROJECTION	UNIT	SCALE	PROJECT: SolBank3.0 0.25P-US-LH	
CHECKED BY	DATE	APPROVED BY	DATE		A0		mm	1:1	PART NO.:	