




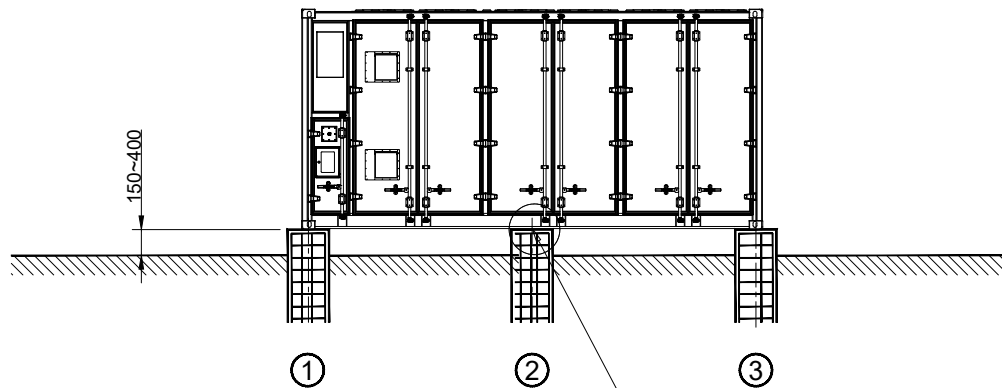


Container bottom beam will be slightly higher than the overall height of the four corners about 13mm, so the middle support of the ground foundation than the four need to be 13 ~ 15mm higher

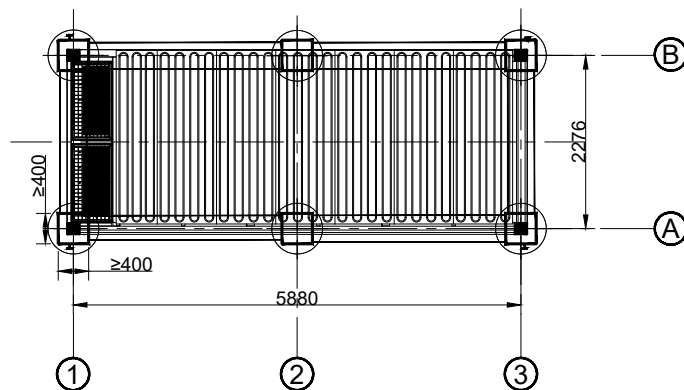



General notes:

1. The support bottom beam support height in the middle of the enclosure is 13~15mm higher than the height of the four corners.
2. There are two recommended solutions for the fixing of the enclosure, the display diagram is a schematic diagram, the position to be fixed is the bottom corner of A1/A3/B1/B3.
 - 2.1 can be strengthened by auxiliary fittings for fixing.
 - 2.2 pre-buried steel plate through the ground foundation and welded connection with the four corners of the enclosure bottom.
3. Foundation levelness tolerances required: the foundation flatness from end-to-end after leveling shall not exceed 0.2% of the container's total length (0.002L), or ± 6 mm (0.24").

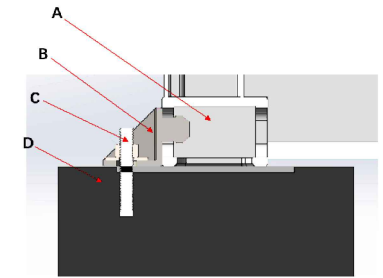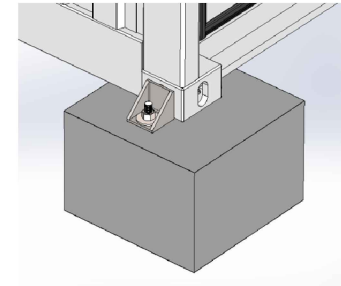

Fasteners recommended for each auxiliary fixture

NO.	Function Module	Quantity	Recommended Specifications
A	Container corner pieces	4	Standard product/self-contained
B	Container twist lock	4	Provided by e-Storage
C	Expansion Bolts & Spacers & Nuts	4	Mechanical or chemical
D	Fixed base	4	Reinforced concrete

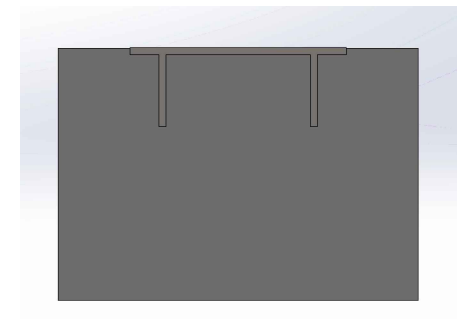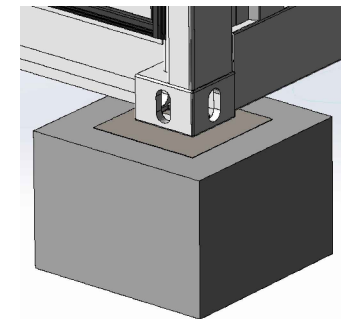

					 CanadianSolar All rights reserved. No part of this document may be reproduced or transmitted in any form without the written permission of CSI.				DRAWING NAME: Solbank standalone installation diagram				
NO.	Original Drawing NO.	Change Description		signature					DATE	DRAWING NO.: M150			
DESIGNED BY		DATE	Standardizing		DATE		PROJECT: SolBank3.0 0.25P-US-LH						
CHECKED BY		DATE	APPROVED BY		DATE		REV.		PROJECTION ANGLE	UNIT	SCALE	PART NO.:	
							A0		mm	1:1			